


# DECK FORM

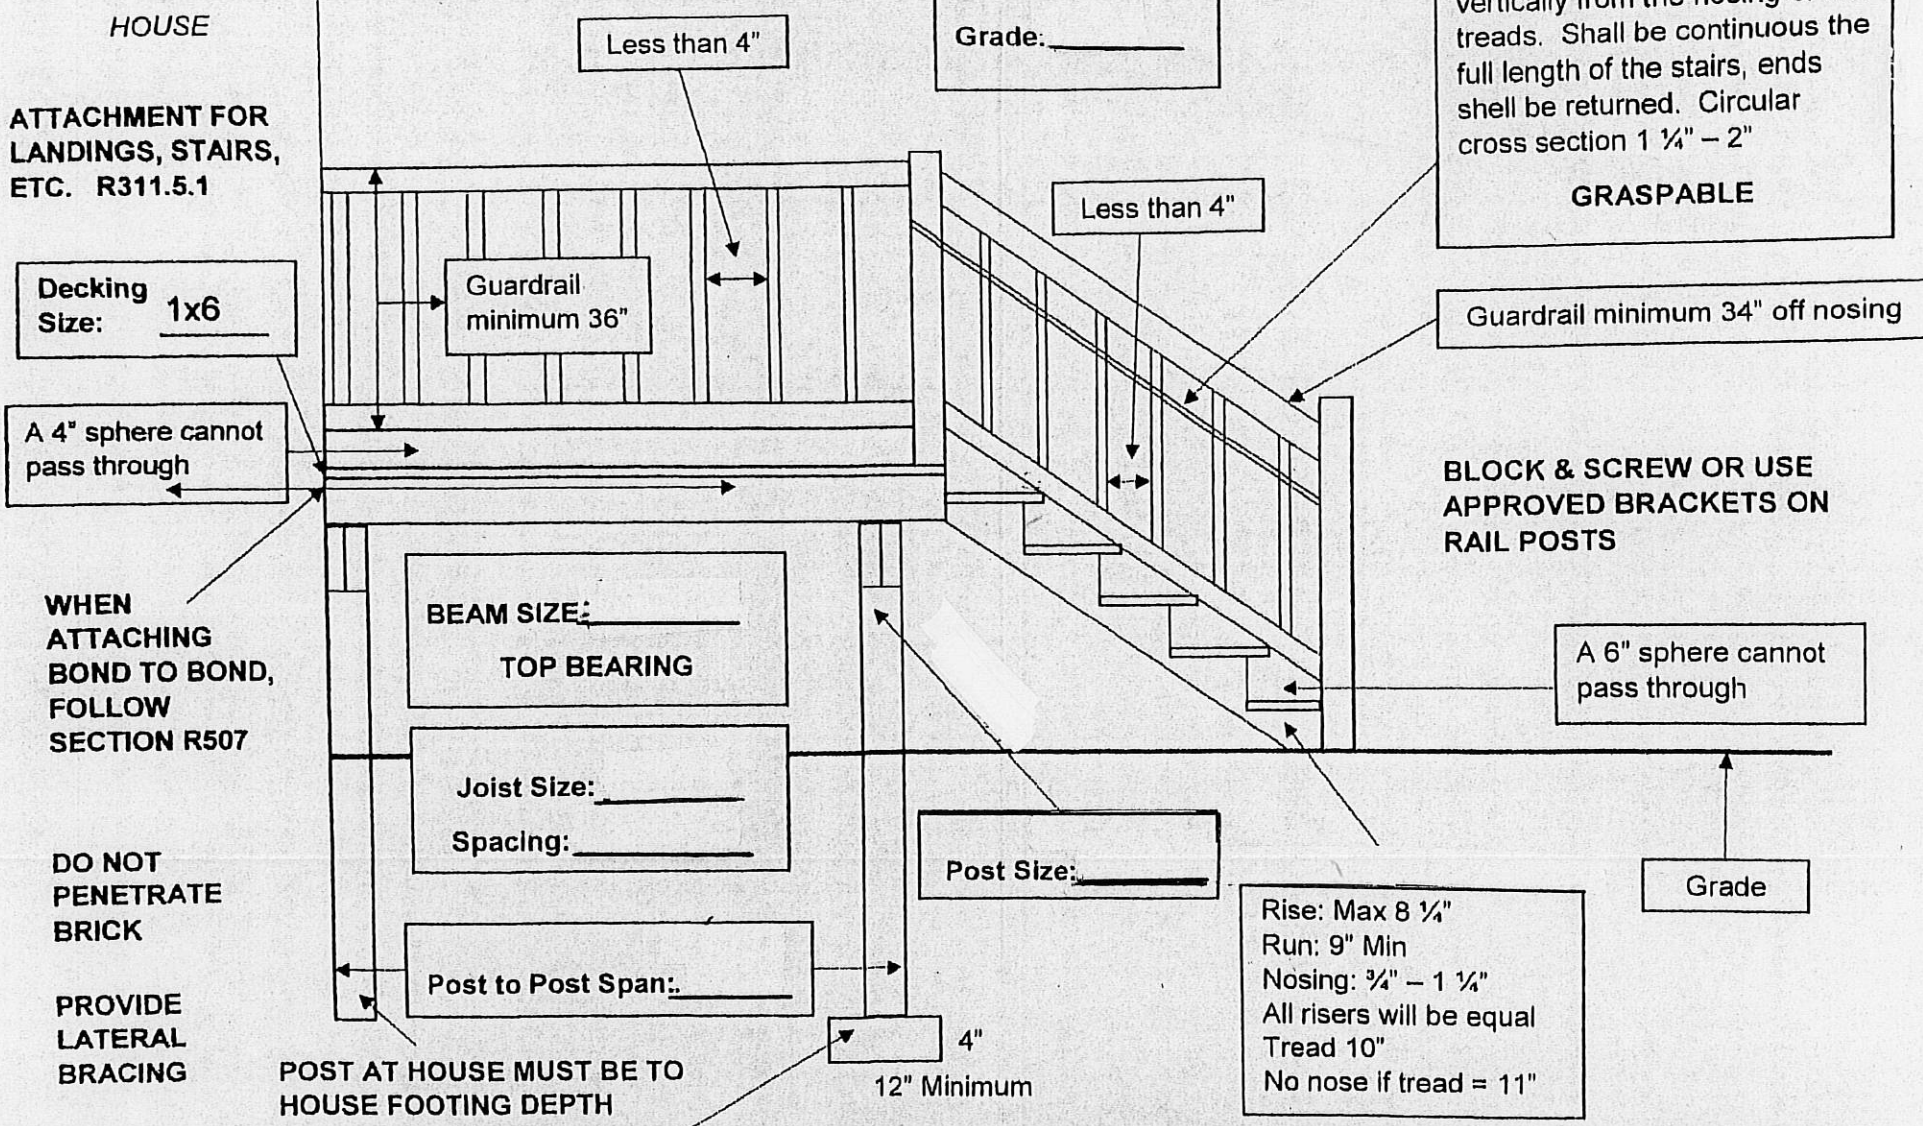

HOUSE

ATTACHMENT FOR LANDINGS, STAIRS, ETC. R311.5.1

Decking Size: 1x6

A 4" sphere cannot pass through

WHEN ATTACHING BOND TO BOND, FOLLOW SECTION R507

DO NOT PENETRATE BRICK

PROVIDE LATERAL BRACING

All Post Must Bear on Undisturbed Soil - Minimum 42" below Finish Grade

Less than 4"

Height Above Grade: \_\_\_\_\_

Guardrail minimum 36"

Less than 4"

Handrails: 34" - 38" measured vertically from the nosing of the treads. Shall be continuous the full length of the stairs, ends shall be returned. Circular cross section 1 1/4" - 2"

**GRASPABLE**

Guardrail minimum 34" off nosing

BLOCK & SCREW OR USE APPROVED BRACKETS ON RAIL POSTS

A 6" sphere cannot pass through

BEAM SIZE: \_\_\_\_\_  
TOP BEARING

Joist Size: \_\_\_\_\_  
Spacing: \_\_\_\_\_

Post Size: \_\_\_\_\_

Post to Post Span: \_\_\_\_\_

Rise: Max 8 1/4"  
Run: 9" Min  
Nosing: 3/4" - 1 1/4"  
All risers will be equal  
Tread 10"  
No nose if tread = 11"

Grade

POST AT HOUSE MUST BE TO HOUSE FOOTING DEPTH

4"  
12" Minimum

Footing: 42"

**\*\*\*PLEASE FILL IN ALL REQUIRED INFORMATION\*\*\***

Revised: 3/20/18

Beam/Post Connection Method and Hardware to be Used: Thru-loks with the 4x6 or 6x6 notched